



Date: 05/03/2019

BSUoS Charge Estimate: £1.76/MWh
Total Outturn: £2.37m




Daily Balancing Costs



BM Cost (Indicative)
AS Cost (Estimate)



- Energy Imbalance
- Positive Reserve (Op Res + STOR)
- Negative Reserve (Footroom)
- Frequency Control (Response + Fast Reserve)
- Other Reserve (Ancillary Costs Only)
- Constraints (BM & Trades only)
- Other (Reactive + Black Start + BM & AS General)

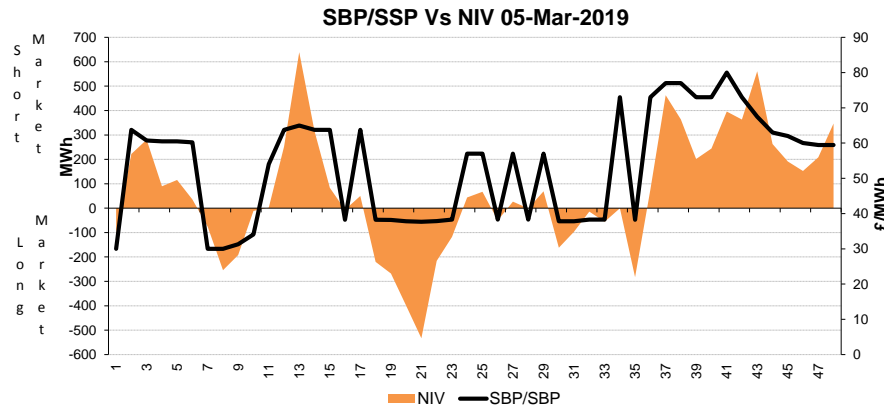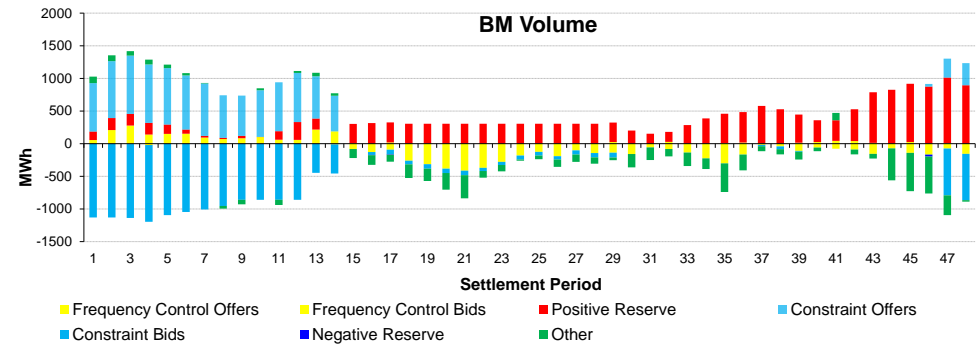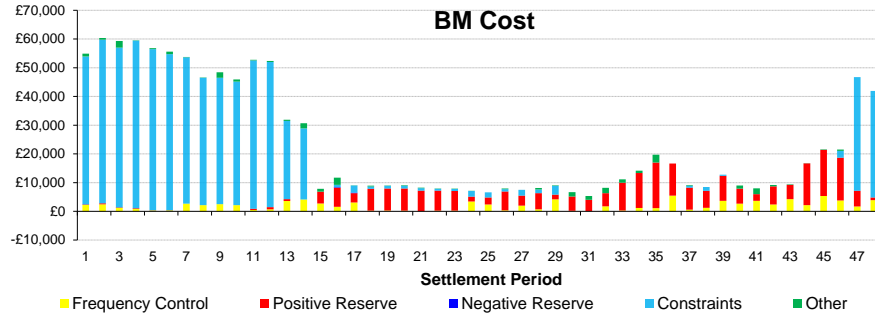

Western Link status: Unavailable

Commentary

System was tightly balanced and flipping between long and short for much of the day. 317MW of STOR was utilised over the morning pick up. Trades on the interconnectors and BMUs were combined with BM actions to manage ROCOF levels overnight. BM actions were required to solve constraints in Scotland overnight and trades and BM actions were required to manage Voltage levels in the Midlands, North East and North West.