

# Dynamic FFR Excel Analysis Tool 2019

## User Guide

**Author:** Honor Hynes  
Customer Technical Policy

**Date:** 12/07/2019

### Introduction

This User Guide describes how to use the 'NGESO FFR Dynamic Analysis Tool 2019' to assess pre-qualification test results as specified in [<insert link to test Guidance>](#) for Providers wishing to enter into a contract to provide Dynamic Firm Frequency Response. The following sections are included:

- Prepare Test Data
- Populate Excel Analysis Tool
- Analyse Results against pass criteria
- Test Report


Step	Action	Description	Examples																																																						
<b>Prepare Test Data</b>																																																									
1	Format test data to be pasted into Tool.	Where applicable test data should be aggregated on a separate sheet to paste the total test volumes into the Tool.	<table border="1"> <thead> <tr> <th>Time (s)</th> <th>Frequency (Hz)</th> <th>Active Power (MW)</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>50</td> <td>0</td> </tr> </tbody> </table>	Time (s)	Frequency (Hz)	Active Power (MW)	0	50	0																																																
Time (s)	Frequency (Hz)	Active Power (MW)																																																							
0	50	0																																																							
2	Overall response values should be copied into the Tool. e.g. Total aggregated data or, where baseline and measured power are provided, these need to be subtracted to provide a response value.	<p>The Tool assumes that the response looks like generation i.e. Low frequency=generation increase. High frequency=generation decrease Check response values are +ve or -ve accordingly.</p>																																																							
<b>Populate Excel Analysis Tool</b>																																																									
3	General	<p>Green cells can be edited. Pink cells are automatically populated. Formulae and tolerance bands assume test injections are identical to the published version. If not, timings/ ranges may need to be altered.</p>																																																							
4	Clear previous test data	In each Test data tab, delete the previous data from 'Frequency' and 'Active Power' columns.																																																							
5	<p>'Response' tab Copy contracted values into the green cells in 'response' tab. Check units are the same as raw data.</p>	<p>Units in this table should be the same as those in the measured test data. Note: High Frequency response values should be negative.</p>	<table border="1"> <thead> <tr> <th rowspan="2">Frequency Deviation (Hz)</th> <th colspan="2">Primary ()</th> <th colspan="2">Secondary ()</th> <th colspan="2">High ()</th> <th rowspan="2">kW or MW? Active Power (MW)</th> </tr> <tr> <th>Contracted</th> <th>Actual</th> <th>Contracted</th> <th>Actual</th> <th>Contracted</th> <th>Actual</th> </tr> </thead> <tbody> <tr> <td>0.1Hz</td> <td>1.0</td> <td>1.0</td> <td>1.0</td> <td></td> <td>-1.0</td> <td>-1.0</td> <td></td> </tr> <tr> <td>0.2Hz</td> <td>2.0</td> <td>2.0</td> <td>2.0</td> <td></td> <td>-2.0</td> <td>-2.0</td> <td></td> </tr> <tr> <td>0.3Hz</td> <td>3.0</td> <td>3.0</td> <td>3.0</td> <td></td> <td>-3.0</td> <td>-3.0</td> <td></td> </tr> <tr> <td>0.4Hz</td> <td>4.0</td> <td>4.0</td> <td>4.0</td> <td></td> <td>-4.0</td> <td>-4.0</td> <td></td> </tr> <tr> <td>0.5Hz</td> <td>5.0</td> <td>5.0</td> <td>5.0</td> <td>5.0</td> <td>-5.0</td> <td>-5.0</td> <td></td> </tr> </tbody> </table>	Frequency Deviation (Hz)	Primary ()		Secondary ()		High ()		kW or MW? Active Power (MW)	Contracted	Actual	Contracted	Actual	Contracted	Actual	0.1Hz	1.0	1.0	1.0		-1.0	-1.0		0.2Hz	2.0	2.0	2.0		-2.0	-2.0		0.3Hz	3.0	3.0	3.0		-3.0	-3.0		0.4Hz	4.0	4.0	4.0		-4.0	-4.0		0.5Hz	5.0	5.0	5.0	5.0	-5.0	-5.0	
Frequency Deviation (Hz)	Primary ()		Secondary ()		High ()		kW or MW? Active Power (MW)																																																		
	Contracted	Actual	Contracted	Actual	Contracted	Actual																																																			
0.1Hz	1.0	1.0	1.0		-1.0	-1.0																																																			
0.2Hz	2.0	2.0	2.0		-2.0	-2.0																																																			
0.3Hz	3.0	3.0	3.0		-3.0	-3.0																																																			
0.4Hz	4.0	4.0	4.0		-4.0	-4.0																																																			
0.5Hz	5.0	5.0	5.0	5.0	-5.0	-5.0																																																			

Step	Action	Description	Examples																		
	Drop down cell J7 and select correct units.	'Actual' response values will be automatically populated from Test 1 and 2 results.																			
6	Pre-frequency change average: For Tests 1 and 2, to provide a reference from which to measure the response delivered, the average power is calculated for the 10 seconds before the frequency change.	Check/adjust the range to cover the 10s prior to the frequency change Cell I16 in Test 1 tabs, '=AVERAGE(C202:C301)' Cell F4 in Test 2 tabs '=AVERAGE(C22:C31)'	<table border="1"> <tr> <td>pre-Average</td> <td>0.000000</td> <td></td> </tr> <tr> <td colspan="3"><i>(edit range to average 10s before frequency change)</i></td> </tr> </table>	pre-Average	0.000000		<i>(edit range to average 10s before frequency change)</i>														
pre-Average	0.000000																				
<i>(edit range to average 10s before frequency change)</i>																					
7	Test 1.1, 1.2 Single Asset tabs Copy required data from raw file (check units correct)	These tabs should be used where there is a new asset or group of assets which will be assessed as part of an aggregated unit. These tabs can be duplicated and populated for several different assets as required.	<table border="1"> <thead> <tr> <th>Time (s)</th> <th>Frequency (Hz)</th> <th>Active Power (MW)</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>50</td> <td>0.001</td> </tr> <tr> <td>0.1</td> <td>50</td> <td>0.001</td> </tr> <tr> <td>0.2</td> <td>50</td> <td>0.001</td> </tr> </tbody> </table>	Time (s)	Frequency (Hz)	Active Power (MW)	0	50	0.001	0.1	50	0.001	0.2	50	0.001						
Time (s)	Frequency (Hz)	Active Power (MW)																			
0	50	0.001																			
0.1	50	0.001																			
0.2	50	0.001																			
8	Test 1.1, 1.2 Single Asset tabs  Edit Green Cells - Asset/s Name/Ref  - Time Value at Which Frequency Changes	Primary and Secondary Start, and secondary end, or High start and end, times filled in automatically.  <b>Note:</b> Default assumption that this asset can sustain maximum response for 30 minutes. If not the case, adjust cell adjust cell E17 'Secondary End' for Test 1.1 and E13 'High End' for Test 1,2 accordingly and clearly state in test report.	<table border="1"> <tr> <td>Asset/s Name/Ref</td> <td>NewVol1</td> </tr> <tr> <td>Time Value at Which Frequency Changes</td> <td>30</td> </tr> <tr> <td>Primary Start</td> <td>40</td> </tr> <tr> <td>Secondary Start</td> <td>60</td> </tr> <tr> <td>Secondary End</td> <td>1829.9</td> </tr> </table> <table border="1"> <tr> <td>Asset/s Name/Ref</td> <td>NewVol1</td> </tr> <tr> <td>Time Value at Which Frequency Changes</td> <td>30</td> </tr> <tr> <td>High Start</td> <td>40</td> </tr> <tr> <td>High End</td> <td>1829.9</td> </tr> </table>	Asset/s Name/Ref	NewVol1	Time Value at Which Frequency Changes	30	Primary Start	40	Secondary Start	60	Secondary End	1829.9	Asset/s Name/Ref	NewVol1	Time Value at Which Frequency Changes	30	High Start	40	High End	1829.9
Asset/s Name/Ref	NewVol1																				
Time Value at Which Frequency Changes	30																				
Primary Start	40																				
Secondary Start	60																				
Secondary End	1829.9																				
Asset/s Name/Ref	NewVol1																				
Time Value at Which Frequency Changes	30																				
High Start	40																				
High End	1829.9																				

Step	Action	Description	Examples
9	Test 1.1, 1.2 Single Asset tabs The Tool calculates the response values shown by taking the <b>minimum</b> response value achieved for each timescale.	e.g Primary response = MINIMUM (from 10 to 30 seconds following start of 0.5Hz frequency step) minus (pre-average).	<div style="display: flex; flex-direction: column; align-items: center;"> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> <span style="background-color: #4F81BD; color: white; padding: 2px;">Primary Response</span>  <span style="background-color: #E06666; color: white; padding: 2px;">1.009</span> </div> <div style="border: 1px solid black; padding: 2px; margin-bottom: 5px;"> <span style="background-color: #4F81BD; color: white; padding: 2px;">Secondary Response</span>  <span style="background-color: #E06666; color: white; padding: 2px;">1.009</span> </div> <div style="border: 1px solid black; padding: 2px;"> <span style="background-color: #4F81BD; color: white; padding: 2px;">High Response</span>  <span style="background-color: #E06666; color: white; padding: 2px;">-1.009</span> </div> </div>

10 Test 1.1 and 1.2 Total Repeat Steps 6, 7 and 8


Used for the total test volume. In addition to the total Primary, Secondary and High frequency response values, this also calculates Standard Deviation over the 30 minute period and displays an additional close up graph to check that the total unit starts to respond within 2 seconds.

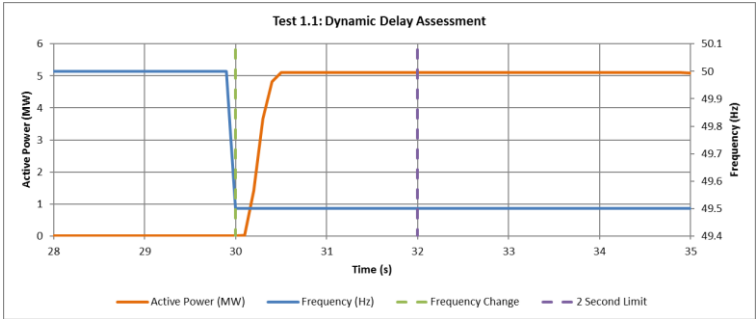

11 **Test 2.1 and 2.2**  
Enter data in the same way as for Test 1.

**Note:** All calculations and tolerance bands assume frequency injection aligns with the published version.

Time (s)	Frequency (Hz)	Active Power (MW)
0	50	0.00
1	50	0.00
2	50	0.00
3	50	0.00
4	50	0.00

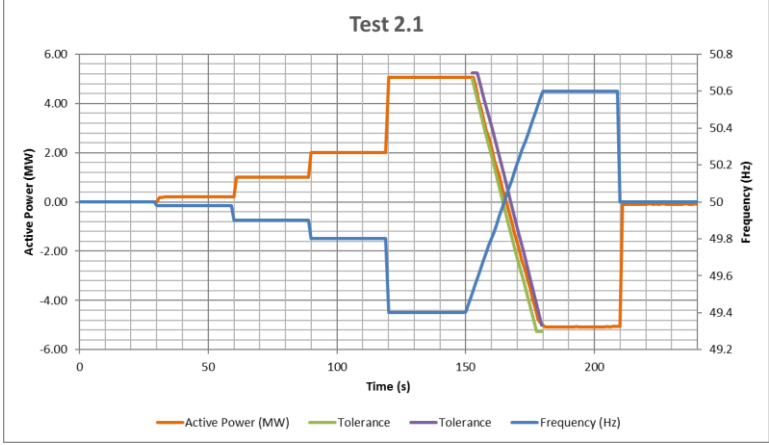

**Step**      **Action**      **Description**

12      Test 2.1 and 2.2      Pre-average as for Step 5 above.  
 For Tests 2b, c and d, the 'Actual' values are calculated as the minimum response observed from 10 – 29 seconds after each step.  
 e.g. Test 2.1.c  
 'Actual' = MIN(C102:C121)-F4

For Test 2.1e the tolerance bands are automatically calculated but need to align with published frequency injection.

**Examples**

pre-Average	0.001000					
<i>(edit range to average 10s before frequency change)</i>						
Frequency Deviation (Hz)	Primary ()		Test ref			
	Contracted	Actual				
0.1Hz	1.0	0.999	2.1b			
0.2Hz	2.0	2.001	2.1c			
0.3Hz	3.0	3.017	Derived from c and d			
0.4Hz	4.0	4.033	Derived from c and d			
0.5Hz	5.0	5.049	2.1d	Test 1 result	5.046	
<b>Test 2.1e Tolerance Bands</b>						
Maximum Contracted Resp	5.00	High max	5.00			
Time	Expected %	Contracte	Left %	Right %	Left Band	Right Banc
152.5	100	5	0.0	5.0	5	5.25
154.5	84	4.2	-0.8	21.0	4.16	5.25
155	80	4	-1.0	21.0	3.95	5.05
157.5	60	3	-2.0	21.0	2.9	4.05
160	40	2	-3.0	21.0	1.85	3.05
162.5	20	1	-4.0	21.0	0.8	2.05
165	0	0	-5.0	21.0	-0.25	1.05
167.5	-20	-1	-5.0	20.2	-1.25	0.01
170	-40	-2	-5.0	19.3	-2.25	-1.035
172.5	-60	-3	-5.0	18.4	-3.25	-2.08
175	-80	-4	-5.0	17.6	-4.25	-3.12
177.5	-100	-5	-5.0	16.7	-5.25	-4.165
179.5	-100	-5	-5.0	0.0	-5.25	-5


13      Test 3  
 Copy required data from raw file.

Time (s)	Frequency (Hz)	Active Power (MW)
0.0	50.07	-0.01
1.0	50.07	-0.75
2.0	50.07	-0.76
3.0	50.07	-0.75
4.0	50.07	-0.78
5.0	50.07	-0.76
6.0	50.07	-0.74
7.0	50.07	-0.72
8.0	50.07	-0.69
9.0	50.06	-0.67
10.0	50.06	-0.64
11.0	50.06	-0.61
12.0	50.05	-0.58
13.0	50.05	-0.53
14.0	50.05	-0.50
15.0	50.05	-0.50

Step	Action	Description	Examples
14	Test 3 Frequency axis is reversed. Frequency Axis Range should mirror corresponding active power in response table.	For the 5MW sample Unit shown, the frequency range 50.2Hz to 49.8Hz aligns with -2MW to +2MW.	
15	Test 3 Expected Response	Column E in the Test 3 tab calculates the expected response against frequency (without considering delay) and gives a value of zero if the frequency is inside the deadband range.	

Analyse Results against pass criteria.

16 **Test 1.1 and 1.2 - Single Asset** which will be assessed as part of an aggregated facility.  
Record Primary/Secondary/High Note duration

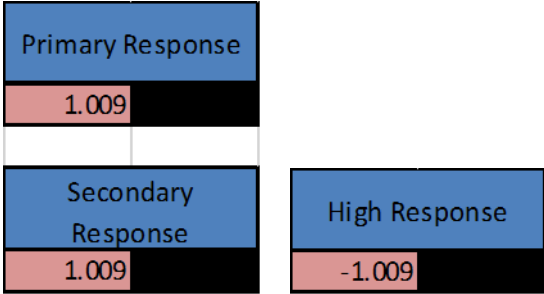


Step	Action	Description	Examples																																																												
17	<p><b>Test 1.1 and 1.2 Total</b></p> <p>Minimum total response achieved within each timescale can be found in the Test 1 'total' tabs and will also populate the 'Actual' values for 0.5Hz frequency deviation in the 'Response' tab.</p>		<div style="display: flex; flex-direction: column; align-items: flex-start;"> <div style="margin-bottom: 10px;"> <table border="1" style="background-color: #4a7ebb; color: white;"> <tr><th colspan="2">Primary Response</th></tr> <tr><td style="background-color: #e06666;">5.046</td><td style="background-color: black;"></td></tr> </table> </div> <div style="margin-bottom: 10px;"> <table border="1" style="background-color: #4a7ebb; color: white;"> <tr><th colspan="2">Secondary Response</th></tr> <tr><td style="background-color: #e06666;">5.046</td><td style="background-color: black;"></td></tr> </table> </div> <div style="margin-bottom: 10px;"> <table border="1" style="background-color: #4a7ebb; color: white;"> <tr><th colspan="2">High Response</th></tr> <tr><td style="background-color: #e06666;">-5.046</td><td style="background-color: black;"></td></tr> </table> </div> <table border="1" style="width: 100%; text-align: center;"> <thead> <tr> <th rowspan="2">Frequency Deviation (Hz)</th> <th colspan="2">Primary ()</th> <th colspan="2">Secondary ()</th> <th colspan="2">High ()</th> </tr> <tr> <th>Contracted</th> <th>Actual</th> <th>Contracted</th> <th>Actual</th> <th>Contracted</th> <th>Actual</th> </tr> </thead> <tbody> <tr><td>0.1Hz</td><td style="background-color: #92d050;">1.0</td><td style="background-color: #e06666;">1.0</td><td style="background-color: #92d050;">1.0</td><td style="background-color: #808080;"></td><td style="background-color: #e06666;">-1.0</td><td style="background-color: #e06666;">-1.0</td></tr> <tr><td>0.2Hz</td><td style="background-color: #92d050;">2.0</td><td style="background-color: #e06666;">2.0</td><td style="background-color: #92d050;">2.0</td><td style="background-color: #808080;"></td><td style="background-color: #e06666;">-2.0</td><td style="background-color: #e06666;">-2.0</td></tr> <tr><td>0.3Hz</td><td style="background-color: #92d050;">3.0</td><td style="background-color: #e06666;">3.0</td><td style="background-color: #92d050;">3.0</td><td style="background-color: #808080;"></td><td style="background-color: #e06666;">-3.0</td><td style="background-color: #e06666;">-3.0</td></tr> <tr><td>0.4Hz</td><td style="background-color: #92d050;">4.0</td><td style="background-color: #e06666;">4.0</td><td style="background-color: #92d050;">4.0</td><td style="background-color: #808080;"></td><td style="background-color: #e06666;">-4.0</td><td style="background-color: #e06666;">-4.0</td></tr> <tr><td>0.5Hz</td><td style="background-color: #92d050;">5.0</td><td style="background-color: #e06666;">5.0</td><td style="background-color: #92d050;">5.0</td><td style="background-color: #e06666;">5.0</td><td style="background-color: #e06666;">-5.0</td><td style="background-color: #e06666;">-5.0</td></tr> </tbody> </table> </div>	Primary Response		5.046		Secondary Response		5.046		High Response		-5.046		Frequency Deviation (Hz)	Primary ()		Secondary ()		High ()		Contracted	Actual	Contracted	Actual	Contracted	Actual	0.1Hz	1.0	1.0	1.0		-1.0	-1.0	0.2Hz	2.0	2.0	2.0		-2.0	-2.0	0.3Hz	3.0	3.0	3.0		-3.0	-3.0	0.4Hz	4.0	4.0	4.0		-4.0	-4.0	0.5Hz	5.0	5.0	5.0	5.0	-5.0	-5.0
Primary Response																																																															
5.046																																																															
Secondary Response																																																															
5.046																																																															
High Response																																																															
-5.046																																																															
Frequency Deviation (Hz)	Primary ()		Secondary ()		High ()																																																										
	Contracted	Actual	Contracted	Actual	Contracted	Actual																																																									
0.1Hz	1.0	1.0	1.0		-1.0	-1.0																																																									
0.2Hz	2.0	2.0	2.0		-2.0	-2.0																																																									
0.3Hz	3.0	3.0	3.0		-3.0	-3.0																																																									
0.4Hz	4.0	4.0	4.0		-4.0	-4.0																																																									
0.5Hz	5.0	5.0	5.0	5.0	-5.0	-5.0																																																									
18	<p><b>Test 1.1 and 1.2 Total</b></p> <p>Check delay in response of active power due to a change in frequency is no greater than 2 seconds.</p>	<p>Dynamic delay assessment graph</p> <p>For each test, alter the dynamic delay graph so the x-axis shows a close up before and after the frequency change point.</p>																																																													
19	<p><b>Test 1.1 and 1.2 Total</b></p> <p>The Unit should progressively change to its maximum response</p>	<p>Shown in the Delay Assessment graph (Step 18).</p> <p>The unit should start to respond within 2 seconds and progress monotonically towards its maximum response.</p>																																																													
20	<p><b>Test 1.1 and 1.2 Total</b></p> <p>Check that the standard deviation of load error at steady state over a 30 minute period does not exceed 2.5% of the maximum contracted active power response.</p>	<p>Standard deviation is assessed from 10 seconds until 30 minutes after the frequency step, unless the contracted values for primary and secondary are different. In this case, standard deviation is assessed from 30 seconds until 30 minutes after the frequency step.</p>	<table border="1" style="width: 100%; text-align: center;"> <tr><td style="background-color: #e06666;">SD</td><td style="background-color: #4a7ebb; color: white;">0.000534</td></tr> <tr><td style="background-color: #4a7ebb; color: white;">% SD</td><td style="background-color: #e06666;">0.011</td></tr> </table>	SD	0.000534	% SD	0.011																																																								
SD	0.000534																																																														
% SD	0.011																																																														


Step	Action	Description	Examples
------	--------	-------------	----------

Note: SD calculation assumes Primary = Secondary.  
 If Primary ≠ Secondary then change cell J13 formula to =STDEV.P(INDIRECT(J9&"."&J10))

21 **Test 1.1 and 1.2 Total**  
 Check response is sustained for 30 minutes

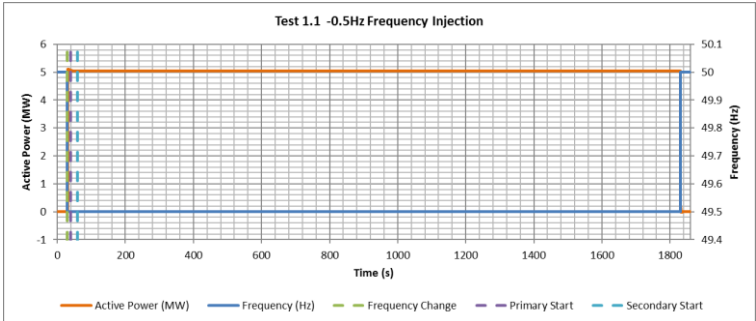

22 **Test 2.1 and 2.2**  
 For Tests 2.1a and 2.2a check that a noticeable change in power in the correct direction is observed.

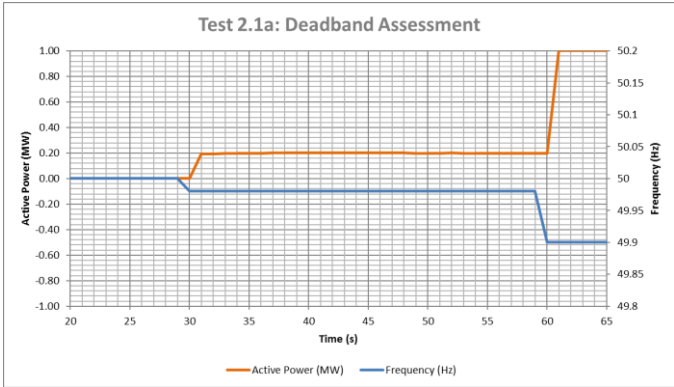

23 **Test 2.1 and 2.2**  
 See Step 12 for Test 2.1 and 2.2 b, c and d.  
 These values will populate the 'Response' tab  
 Check that minimum of the sampled values of active power within primary, secondary and high frequency

For each test the 'Actual' values are taken from the (minimum value observed within Primary, Secondary or High Frequency response timescales) minus (Pre-frequency change average)  
 The error shown in the table opposite (from 'Response' tab) is a percentage of the expected

Frequency Deviation (Hz)	Tolerance	Primary (I)			Secondary (I)			High (I)		
		Contracte	Actual	Error %	Contracte	Actual	Error %	Contracte	Actual	Error %
0.1Hz	5%/-4%	1	1.00	-0.10	1	0.00	-100.00	-1	-1.00	0.02
0.2Hz	5%/-3%	2	2.00	0.05	2	0.00	-100.00	-2	-2.00	0.04
0.3Hz	5%/-2%	3	3.02	0.57	3	0.00	-100.00	-3	-3.02	0.40
0.4Hz	5%/-1%	4	4.03	0.82	4	0.00	-100.00	-4	-4.04	0.76
0.5Hz	5%/-0%	5	5.05	0.92	5	5.05	0.92	-5	-5.05	0.92



Step	Action	Description	Examples
	<p>timescales are within the allowable tolerances.</p>	<p>response for that frequency deviation.</p> <p>= ('Actual'-'Contracted') / Actual*100</p> <p><b>Note:</b> Secondary response is not assessed here for 0.1Hz- 0.4Hz frequency deviation.</p>	
<p>24</p>	<p><b>Test 2.1e and 2.2e</b></p> <p>Check that active power response is within the tolerances specified in Test Guidance.</p>	<p>If a small number of data samples fall outside the tolerance bands, this should be investigated and explained.</p>	
<p>25</p>	<p><b>Test 3</b></p> <p>Check that active power response is consistent with the contracted performance within Primary, Secondary and/or High frequency response timescales.</p>	<p>The frequency axis has been reversed. Scale both vertical axes to be consistent with the total test volume. Once displayed this way, the active power can be clearly seen performing as expected. Inside the deadband, the active power response may move to zero. (There is no obligation to have a deadband. If the Unit does continue to respond within the deadband then it should respond proportionally with frequency.)</p> <p>Any unusual or unexpected performance should be investigated and explained. A re-test may be required.</p>	

---

Step	Action	Description	Examples
------	--------	-------------	----------

---

**Test Report**

---

26	Write report giving feedback on test results.	See report template	
----	---	---------------------	--

---