

# NOA Stability Pathfinder Phase 2

Expression of Interest Summary



# Version control

Version	Date published	Page No.	Comments
1.0	22/02/2021		

# Legal disclaimer and copyright

## Disclaimer

This guidance document has been prepared by National Grid Electricity System Operator (NGESO) and is provided voluntarily and without charge. Whilst NGESO has taken all reasonable care in preparing this document, no representation or warranty either expressed or implied is made as to the accuracy or completeness of the information that it contains and parties using information within the document should make their own enquiries as to its accuracy and suitability for the purpose for which they use it. Neither NGESO nor any other companies in the National Grid plc group, nor any directors or employees of any such company shall be liable for any error or misstatement or opinion on which the recipient of this document relies or seeks to rely other than fraudulent misstatement or fraudulent misrepresentation and does not accept any responsibility for any use which is made of the information or the document or (to the extent permitted by law) for any damages or losses incurred.

Copyright National Grid ESO 2020, all rights reserved.


# Summary of submissions

The Expression of Interest (EOI) invited potential participants to express an interest in participating in the NOA Stability Pathfinder Phase 2 tender process which is seeking to procure short circuit level, inertia and dynamic voltage services. The EOI closed on 8th January 2021 and we received 29 submissions with 1575 solutions.

All solutions have passed the EOI stage and have qualified to progress to the feasibility study stage.


- 29 Submissions
- 3 Technology categories
- 1575 Solutions
- 67 Substations (different voltage levels/sites)

Solutions by Technology Type

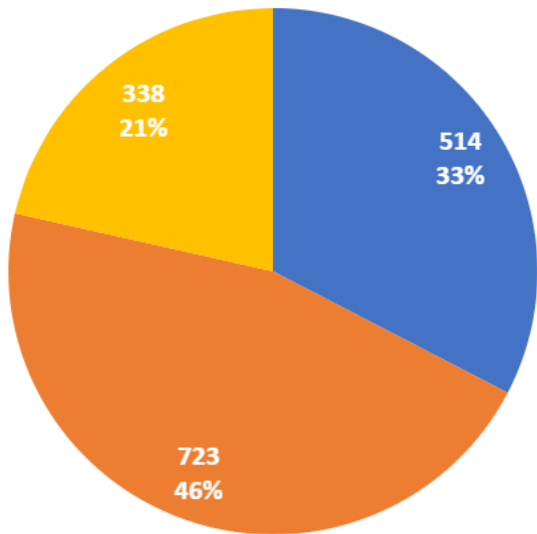


■ Synchronous machines ■ Grid forming converters ■ Hybrid\*

Substations by Transmission Owner Area

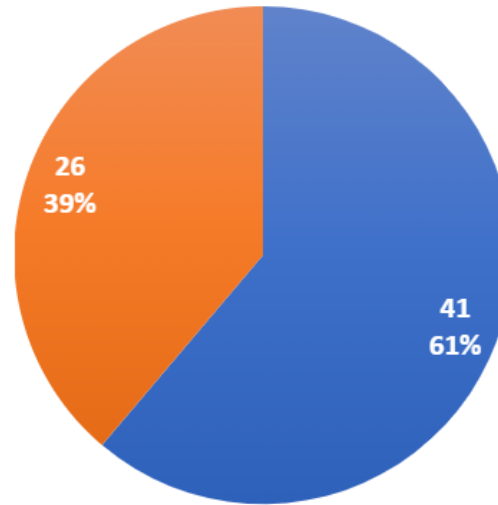

■ Scottish Power Transmission  
■ Scottish Hydro Electric Transmission\*\*

Solutions by Voltage Level

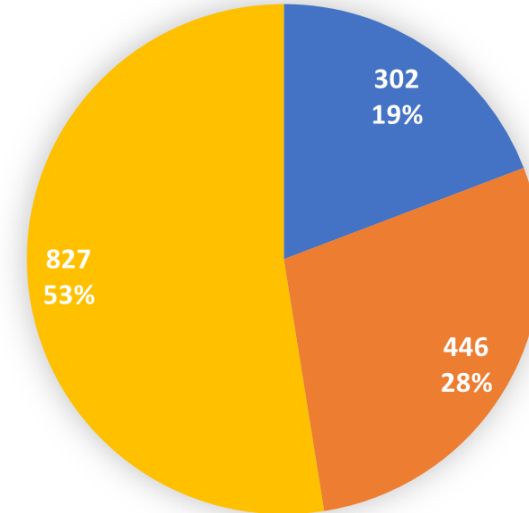

■ 132kV ■ 275kV ■ 400kV

\*Synchronous Condenser and Battery Storage System with Grid Forming Converter

\*\*includes solutions connecting via OFTO