

**Grid Code Review Panel
Data Validation & Consistency Checking Rules**

A paper by National Grid (Tariq Hakeem)

Exec Summary

1. Balancing Mechanism data submitted by Trading Agents and BM (Balancing Mechanism) Control Points is subject to validation and consistency checks. The rules governing these checks are defined in the Grid Code Associated Document titled "Data Validation, Consistency & Defaulting Rules"¹. This document defines the validation and consistency checks which are applied to the data received; it also covers defaulting rules to be applied in the absence of expected data.
2. The Glossary and Definitions section of the Grid Code references the Data Validation, Consistency and Defaulting Rules document along with the version number and date issued. The current version of the document referenced in the Grid Code is version 7 dated 11th October 2004. This version was approved by the Authority following a consultation undertaken by National Grid - A/04 ("Changes to the 'Data Validation, Consistency and Defaulting Rules' and associated definition in the Grid Code"²)
3. This paper identifies a requirement for modification to be made to the two documents:
 - **Data Validation, Consistency and Defaulting Rules** - The GCRP is asked to **note** the changes proposed by National Grid to the Associated Document and **note** that an informal consultation will be issued.
 - GB Grid Code – definition for "Data Validation, Consistency and Defaulting Rules" would need to be updated to refer to the new revision. The GCRP is asked to **agree** that a Grid Code Consultation is raised.

Issue

4. The Grid Code requires those wishing to participate in the Balancing Mechanism (BM) to have EDL (Electronic Logging Device) installed, National Grid have encouraged participation in the BM by accepting Bid Offer Data from generators without EDL (whilst they continue to progress its installation). This interim mechanism is effective for low levels of despatch instructions.
5. Recent experience of high wind conditions has evidenced that issuing multiple despatch instructions through manual means is impractical due to the time taken to issue a BOA and is detrimental to system security. Following a review of events during high wind conditions it has been concluded that this interim arrangement of manual despatch should cease from midnight 1st January 2012. From this point, if system conditions make it necessary, Emergency Instructions will be issued to generators that have not installed EDL³. This will be the only

¹http://www.nationalgrid.com/NR/ronlyres/EA72E14A-855F-4511-BF4C-37B6DA62280E/1301/DVCDR_Version207.pdf

²<http://www.nationalgrid.com/uk/Electricity/Codes/gridcode/consultationpapers/2004/>

³http://www.nationalgrid.com/NR/ronlyres/691D2EDF-1E4D-4C6F-B954-80C8957174CC/49719/Industry_Letter_Approach_to_EDL_and_Control_Instructions.pdf

form of instruction given through the BM until the generator has an active connection through EDL connection.

6. Bid-Offer data is submitted by parties wishing to participate in the BM via EDT (Electronic Data Transfer) with acceptances issued by National Grid via EDL. As stated above from 1st January 2012, National Grid intends to implement a policy of not issuing telephone Bid-Offer Acceptances to BMU's that have not installed EDL. In order to assist with the implementation of this policy it is proposed that an additional validation rule is applied to Bid-Offer data, such that Bid-Offer data can only be submitted by BM Units with an active EDL connection. This validation rule is consistent with the Grid Code BC1.4.2(d):**"Bid-Offer Data may not be submitted unless an automatic logging device has been installed at the Control Point for the BM Unit in accordance with CC.6.5.8(b)..."**. This additional validation rule will allow operational systems to hold data that is consistent with the requirements of the Grid Code.
7. National Grid is working with a number of parties to install EDL before the 1st January 2012. Not all parties have indicated that they wish to install EDL, if parties do not wish to install EDL, or it is not in place, we will formally request that any previous Bid-Offer data is resubmitted with zero values by 1st January 2012. Following this, a data correction exercise will be undertaken on the 1st January 2012 to ensure operational systems only hold Bid-Offer data from those participants with active EDL connections, consistent with the Grid Code and operational policy. Once the new data validation rule is in place it will ensure going forward that Bid-Offer data is only accepted from parties that have installed EDL.
8. In addition to the new data validation rule proposed above, a review of the Data Validation, Consistency and Defaulting Rules document has identified two other changes that could provide further clarity to the existing validation rules.
 - At present, the Data Validation, Consistency and Defaulting Rules document does not specify what the initial value for each submitted data parameter will be for newly registered BM Units. These initial values can be updated at a later date by Trading Agents / Control Points as required. It is proposed to insert an additional section into the document (Section 6) specifying the initial values for each data item (to avoid null fields).
 - Section 1.3 of the Data Validation, Consistency and Defaulting Rules document specifies definitions and abbreviations used in the document. One such definition is for the value of N which is defined as "A parameter used for some of the following validation rules – initially set to 239". This parameter is used in the validation of NTO (Notice to deliver offers) and NTB (Notice to deliver bids) submitted data. The second validation rule for NTO and NTB states: "The field "NTO value" cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to N minutes" and "The field "NTB value" cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to N minutes". The value of N in the document was not amended when one hour gate closure was introduced; it is proposed that the value of N is amended to 59.

Summary of changes proposed to Data Validation, Consistency and Defaulting Rules document

9. Under section 3.6 of the document (Valid Bid-Offer data) insert an additional validation rule as follows: Bid Offer Data can only be submitted by BM units which have an active EDL installation.
10. Insert an additional section into the document (section 6) which specifies the initial values for a newly setup BM Unit. The proposed section 6 is shown below:

6) Initial Data

When a BM Unit is registered by National Grid and setup within the BM a set of initial values for each of the submitted data items is given. These values are used in the absence of a submission from the responsible Trading Agent/Control Point.

The following values are used for the following data types:

- MEL,PN,QPN,MIL,SEL,BOD,NDZ,MZT & MNZT are all zero
- RURE,RDRE,RURI & RDRI is 10
- MDP is 1
- MDV is 99999
- NTO & NTB is 2

11. Change the parameter of N from an initial 239 to 59.
12. A change marked Data Validation, Consistency and Defaulting Rules document is attached as Appendix 1.

GCRP Recommendations

13. The GCRP is invited to:

- **NOTE** – that National Grid is intending to publish an informal consultation on the following changes to the Data Validation, Consistency & Defaulting Rules document:
 - Introduce a new validation rule such that Bid-Offer data is only accepted from parties with an active EDL installation;
 - Introduce a new section which will specify the default values that will be used for new BM units;
 - Change the value of N from 239 to 59.
- **AGREE** – A Grid Code Consultation is raised in parallel to propose a corresponding amendment to the Grid Code definition for “Data Validation, Consistency and Defaulting Rules”

Appendix 1

Data Validation, Consistency & Defaulting Rules

IS/24.12.0003

Issue 8, 02 November 2011

~~Issue 7, 11/10/04~~

Rob Golding

Approved _____
(BM Design Authority)

Date _____

Approved _____

Date _____

National Grid Company Plc, Information Systems, St Catherine's Lodge,
Bearwood Road, Sindleham, Berkshire, RG41 5BN, UK.
Tel +44 118 9774204



(BM Programme Manager)

CONTENTS

1	INTRODUCTION	1
1.1	Purpose.....	1
1.2	Scope.....	1
1.3	Definitions and Abbreviations	1
1.4	Related Documents	3
2	DIFFERENCES BETWEEN EDL AND EDT	4
3	VALIDATION	5
3.1	Timing Conventions.....	5
3.2	Valid Date/Times	5
3.2.1	EDT Date/Time Formats	5
3.2.2	EDL Date/Time Formats	5
3.3	Other General Validation Rules	6
3.4	Valid Physical Notifications	6
3.5	Valid Quiescent Physical Notifications	7
3.6	Valid Bid-Offer Data	8
3.7	Valid Maximum Export Limits.....	9
3.8	Valid Maximum Import Limits.....	10
3.9	Valid Run-up and Run-down Rates	10
3.9.1	Valid Run-up Rates for an Exporting BMU	12
3.9.2	Valid Run-down Rates for an Exporting BMU	14
3.9.3	Valid Run-up Rates for an Importing BMU	15
3.9.4	Valid Run-down Rates for an Importing BMU	18
3.10	Valid Notice to Deviate from Zero	19

3.11	Valid Notice to Deliver Offers	20
3.12	Valid Notice to Deliver Bids.....	21
3.13	Valid Minimum Zero Time	21
3.14	Valid Minimum Non-Zero Time.....	22
3.15	Valid Stable Export Limit	23
3.16	Valid Stable Import Limit	23
3.17	Valid Maximum Delivery Volume	24
3.18	Valid Maximum Delivery Period.....	24
4	CONSISTENCY	25
4.1	Physical Notification Consistency Rules	25
4.2	Quiescent Physical Notification Rules.....	25
4.3	Bid-offer Consistency Rules	26
4.4	Maximum Export Limit Consistency Rules.....	27
4.5	Maximum Import Limit Consistency Rules.....	27
5	DEFAULTS	28
5.1	Default Data	28
5.2	Defaulting and Clock change Days.....	28
5.3	Default Rule for Physical Notifications	29
5.4	Default Rule for Quiescent Physical Notifications	30
5.5	Default Rule for Maximum Export Limit	30
5.6	Default Rule for Maximum Import Limit	31
5.7	Default Rule for Planning Dynamic Data	31
5.8	Default Rules for Bid-Offer Data.....	32
6	INITIAL DATA	32
APPENDIX A: CLARIFICATION OF GATE CLOSURE AND SUBMISSION MAXIMUM DATE.....		33
A.1	Gate Closure.....	33
A.2	Submission Maximum Date.....	33
DOCUMENT STATUS		35
1	INTRODUCTION.....	1
1.1	Purpose.....	1
1.2	Scope.....	1

1.3	Definitions and Abbreviations	1
1.4	Related Documents	3
2	DIFFERENCES BETWEEN EDL AND EDT	4
3	VALIDATION	5
3.1	Timing Conventions	5
3.2	Valid Date/Times	5
3.2.1	EDT Date/Time Formats	5
3.2.2	EDL Date/Time Formats	5
3.3	Other General Validation Rules	6
3.4	Valid Physical Notifications	6
3.5	Valid Quiescent Physical Notifications	7
3.6	Valid Bid Offer Data	8
3.7	Valid Maximum Export Limits	9
3.8	Valid Maximum Import Limits	10
3.9	Valid Run up and Run down Rates	10
3.9.1	Valid Run up Rates for an Exporting BMU	12
3.9.2	Valid Run down Rates for an Exporting BMU	14
3.9.3	Valid Run up Rates for an Importing BMU	15
3.9.4	Valid Run down Rates for an Importing BMU	18
3.10	Valid Notice to Deviate from Zero	19
3.11	Valid Notice to Deliver Offers	20
3.12	Valid Notice to Deliver Bids	21
3.13	Valid Minimum Zero Time	21
3.14	Valid Minimum Non Zero Time	22
3.15	Valid Stable Export Limit	23
3.16	Valid Stable Import Limit	23
3.17	Valid Maximum Delivery Volume	24
3.18	Valid Maximum Delivery Period	24
4	CONSISTENCY	25
4.1	Physical Notification Consistency Rules	25
4.2	Quiescent Physical Notification Rules	25
4.3	Bid offer Consistency Rules	26
4.4	Maximum Export Limit Consistency Rules	27

4.5	Maximum Import Limit Consistency Rules.....	27
5	DEFAULTS	28
5.1	Default Data	28
5.2	Defaulting and Clock change Days.....	28
5.3	Default Rule for Physical Notifications	29
5.4	Default Rule for Quiescent Physical Notifications	30
5.5	Default Rule for Maximum Export Limit	30
5.6	Default Rule for Maximum Import Limit	31
5.7	Default Rule for Planning Dynamic Data	31
5.8	Default Rules for Bid Offer Data.....	32
APPENDIX A: CLARIFICATION OF GATE CLOSURE AND SUBMISSION MAXIMUM DATE		33
A.1	Gate Closure.....	33
A.2	Submission Maximum Date.....	33
DOCUMENT STATUS		35

1 INTRODUCTION

1.1 Purpose

This document defines the rules for data validation and consistency checking which are applied to Balancing Mechanism data received from Trading Agents and Control Points as part of NETA (see reference 1). It also covers defaulting rules to be applied in the absence of expected data.

The two mechanisms used for data transfer are EDT (for Trading Agents, see reference 2) and EDL (for Control Points, see reference 3). It must be noted that with respect to EDL, only submission messages to NGC will be covered in this document; no information is given concerning bid-offer acceptances and ancillary service instructions sent to Control Points in this document.

1.2 Scope

Under NETA the rules applied to data are simpler than the previous pre-NETA rules detailed in references 4, 5 and 6.

The normal definition of terms still applies. That is, data validation is concerned with checking that data is in the correct format and within the correct limits, e.g. is it an integer, is it between given limits etc.

Data consistency concerns itself with checking if a particular data record is consistent with other data records and defaulting rules are applied in cases of missing data which should have been submitted.

Failure to comply with the validation or consistency rules will result in rejection of the submission for the BMU affected (reference 8 gives details of the high level rules in this area).

This document does not cover physical data formats for EDT or EDL. These issues are covered in references 2 and 3.

1.3 Definitions and Abbreviations

BMU	Balancing Mechanism Unit
CEC	Connection Entry Capacity, as defined in the CUSC
EDT	Electronic Data Transfer – Flat file transfer of submissions
EDL	Electronic Dispatch Logging – A message transfer mechanism
Gate Closure	Gate Closure for a particular Settlement Period is the spot time one Gate Closure Period in advance of the spot time at the start of that Settlement Period (see appendix A for further explanation)

Gate Closure Period	The Gate Closure Period is the length of time between Gate Closure and the spot time at the start of the associated Settlement Period (see appendix A for further explanation)
M	A parameter used for some of the following validation rules – initially set to 239
MEL	Maximum Export Limit
MDP	Maximum Delivery Period
MDV	Maximum Delivery Volume
MIL	Maximum Import Limit
MNZT	Minimum Non-Zero Time
MZT	Minimum Zero Time
N	A parameter used for some of the following validation rules – initially set to 59239
NDZ	Notice to Deviate from Zero
NETA	New Electricity Trading Arrangements
Notification Time	The time at which the transfer of a submission to the NGC System is completed.
NTB	Notice to Deliver Bids
NTO	Notice to Deliver Offers
Operational Day	Runs from 05:00 to 05:00 local time
Submission Maximum Date	A maximum limit will be placed on the date/times allowed in a given submission. From 05:00 to 11:00 local time the Submission Maximum Date is set equal to the end of the current Operational Day + 4 days. From 11:00 to 05:00 local time the Submission Maximum Date is equal to the end of the current Operational Day + 5 days. If a single record within a submission extends beyond this date the entire submission for the BMU would be rejected (see appendix A for further explanation)
PDO	Programme Development Office

PN	The Physical Notification (PN) for a BM Unit is the expected level of export or import for that BM Unit in the absence of any Balancing Mechanism Bid-Offer Acceptances from NGC. The submissions of PN provided at the day-ahead stage for the following Operational Day are termed the Initial Physical Notification (IPN). It is expected that further PNs will be submitted after this time. At Gate Closure, the PN submissions applicable for the period for which the gate has closed then become the Final Physical Notification (FPN) for that period.
QPN	A Quiescent Physical Notification is a MW value expressing the level of demand expected to be consumed by an underlying process that forms part of the operation of a particular BMU at any particular time
RDRE	Run-down Rates for an Exporting BMU
RDRI	Run-down Rates for an Importing BMU
RURE	Run-up Rates for an Exporting BMU
RURI	Run-up Rates for an Importing BMU
SEL	Stable Export Limit
SIL	Stable Import Limit
U	A parameter used for some of the following validation rules – initially set to -99999
V	A parameter used for some of the following validation rules – initially set to 99999

The terms used here are defined in reference 1.

1.4 Related Documents

1. Balancing and Settlement Code, Elexon.
2. EDT Interface Specification, CT/24.12.0002.
3. EDL Message Specification, CT/24.13.0013.
4. Rules for Data Validation, NGC/GRP/67T02.2, Issue 3, December 1998.
5. Rules for Data Consistency, NGC/GRP/68T02.3. Issue 4, June 1998.
6. Electronic Dispatch Logging, Redeclaration Message – Error Checking, NGC/CTC/Comm 112, Issue 4, December 1995.
7. NETA Timing Conventions, NGC/CT/AS/NETA/CRS, Issue 2.
8. “High level principles for data validation, consistency checking and defaulting”, Note to PDO from NGC, 21 January 2000, Issue 2.

2 DIFFERENCES BETWEEN EDL AND EDT

The physical data formats for EDL and EDT are covered in references 2 and 3. EDL is the primary mechanism by which Control Points inform NGC of changes to their operating conditions while EDT is used by Trading Agents to inform NGC of changes to other data. As a result the two mechanisms can have different validation and consistency rules applied to the data submitted. The following table summarises these differences.

Data Item	EDL	EDT
Physical Notifications	Not submitted by EDL	Can be submitted by EDT but only for certain date/times enforced by the rules contained in this document
Quiescent Physical Notifications	Not submitted by EDL	Can be submitted by EDT but only for certain date/times enforced by the rules contained in this document
Bid-Offer Data	Not submitted by EDL	Can be submitted by EDT but only for certain date/times enforced by the rules contained in this document
Maximum Export Limits & Maximum Import Limits	Can be submitted by EDL. (NOTE the rules for EDL and EDT are different)	Can be submitted by EDT but only for certain date/times enforced by the rules contained in this document (NOTE the rules for EDT and EDL are different)
Dynamic Data, i.e. SEL, SIL, RURE, RDRE, RURI, RDRI, NDZ, NTO, NTB, MZT, MNZT, MDV & MDP	Can be submitted by EDL and will be applicable from the Notification Time – this is operational data	Can be submitted by EDT but is only applicable for day ahead indicative planning data (that is this data will never become operational data). Separate sets of data, or subsets, can be submitted for each Operational Day up to and including the Submission Maximum Date.

It is also worth noting that EDL is a message based system while EDT is a file based system. As a result data records sent via EDL are processed separately and will have distinct notification times. However data records sent via EDT are part of a single file and so will have the same notification time. The notification time is important because it determines the precedence of different submissions.

3 VALIDATION

3.1 Timing Conventions

Timing conventions for EDT files follow those given in reference 7.

3.2 Valid Date/Times

Rule Number	Description
V_GEN_1	All date/times must obey the formats given below
V_GEN_2	Any submitted date/times must be valid calendar date/times

Fields designated as date/times must be in GMT (unless it is explicitly stated otherwise in this document) and must be to a resolution of one minute.

Rule V_GEN_2 ensures that a date such as 2000-02-31 will be rejected.

3.2.1 EDT Date/Time Formats

EDT date/time formats follow the convention

YYYY-MM-DD HH:MI

Where the following definitions apply:

YYYY	A 4 digit integer
MM	A 2 digit integer from the set {01..12}
DD	A 2 digit integer from the set {01..31}
HH	A 2 digit number from the set {00..23}
MI	A 2 digit number from the set {00..59}

3.2.2 EDL Date/Time Formats

EDL date formats follow the convention

DD-MON-YYYY HH:MI

Where the following definitions apply:

DD	A 2 digit integer from the set {01..31}
MON	From the set {JAN, FEB, MAR, APR, MAY, JUN, JUL, AUG, SEP, OCT, NOV, DEC}
YYYY	A 4 digit integer
HH	A 2 digit number from the set {00..23}
MI	A 2 digit number from the set {00..59}

3.3 Other General Validation Rules

The following rules enforce checks on the BMU names and the relationship between BMU and Trading Agent. Also there could be general format problems with the submitted data, meaning that validation and consistency rules cannot be applied.

Rule Number	Description
V_GEN_3	Submissions will be checked to ensure that the submitter has the right to send data for a given BMU
V_GEN_4	The BMU must have a valid name
V_GEN_5	It must be possible to process a submission in order to check its validity or consistency. The rule covers cases where the data submission does not follow basic EDT or EDL formats and therefore cannot be checked. For example an EDT file could be so corrupted that individual data items may not be identifiable.

3.4 Valid Physical Notifications

Physical Notifications (PN) can only be submitted via EDT, i.e. EDL does not have the capability to handle this information.

A Physical Notification record consists of the following fields.

- A date/time from.
- A PN level from (units of MW).
- A date/time to.
- A PN level to (units of MW).

Rule Number	Description
V_PN_1	A PN level must be an integer greater than or equal to -9999MW and less than or equal to the Connection Entry Capacity (CEC) of the BMU where such a value exists or an alternative value agreed with the Lead Party where such a value does not exist. In either case, the Lead Party may from time to time choose to submit alternative lower values to validate against.

Rule Number	Description
V_PN_2	Null fields are not allowed
V_PN_3	A Physical Notification “date/time from” must be earlier than its “date/time to”
V_PN_4	The Physical Notification “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.
V_PN_5	The Physical Notification “date/time to” field must be earlier than or equal to the Submission Maximum Date

MW levels for exporters of power would be expected to be positive. MW levels for importers of power would be expected to be negative.

3.5 Valid Quiescent Physical Notifications

Quiescent Physical Notifications (QPN) can only be submitted via EDT, i.e. EDL does not have the capability to handle this information.

A quiescent physical notification record consists of the following fields.

- A date/time from.
- A QPN level from (units of MW).
- A date/time to.
- A QPN level to (units of MW).

Rule Number	Description
V_QPN_1	A QPN level must be an integer greater than or equal to -9999MW and less than or equal to 0MW
V_QPN_2	Null fields are not allowed
V_QPN_3	A Quiescent Physical Notification “date/time from” must be earlier than its “date/time to”
V_QPN_4	The Quiescent Physical Notification “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.
V_QPN_5	The Quiescent Physical Notification “date/time to” field must be earlier than or equal to the Submission Maximum Date

From the ranges allowed for QPN levels it can be deduced that only importers of power are expected to submit non-zero values for Quiescent Physical Notifications.

3.6 Valid Bid-Offer Data

Bid-offer data can only be submitted via EDT, i.e. EDL does not have the capability to handle this information.

A bid-offer record consists of the following fields.

- A date/time from.
- A date/time to.
- A bid-offer pair number.
- A bid-offer level from (units of MW).
- A bid-offer level to (units of MW).
- An offer price (units of £/MWh).
- A bid price (units of £/MWh).

Rule Number	Description
V_BOD_1	The fields “date/time from” and “date/time to” must correspond to settlement half hour period boundaries
V_BOD_2	The field “date/time from” must be earlier than the field “date/time to”
V_BOD_3	The “bid-offer pair number” must be an integer greater than or equal to -5 and less than or equal to 5 <u>BUT must not have the value 0</u>
V_BOD_4	The fields “bid-offer level from” and “bid-offer level to” must be an integer greater than or equal to -9999 MW and less than or equal to 9999 MW
V_BOD_5	The fields “bid-offer level from” and “bid-offer level to” must be equal
V_BOD_6	If the “bid-offer pair number” is positive then the values of the fields “bid-offer level from” and “bid-offer level to” must also be positive or zero. If the “bid-offer pair number” is negative then the values of the fields “bid-offer level from” and “bid-offer level to” must also be negative or zero.
V_BOD_7	Null fields are not allowed

Rule Number	Description
V_BOD_8	All “offer prices” and “bid prices” must be a real number, accurate to 2 decimal places, which must be greater than or equal to -99999.00 £/MWh and less than or equal to 99999.00 £/MWh
V_BOD_9	The bid-offer “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.
V_BOD_10	The bid-offer “date/time to” field must be earlier than or equal to the Submission Maximum Date
V_BOD_11	Bid Offer Data can only be submitted by BM units which have an active EDL installation

3.7 Valid Maximum Export Limits

A Maximum Export Limit (MEL) record consists of the following fields.

- A date/time from.
- A MEL level from (units of MW).
- A date/time to.
- A MEL level to (units of MW).

Rule Number	Description
V_MEL_1	The fields “MEL level from” and “MEL level to” must be integers greater than or equal to 0MW and less than or equal to 9999MW
V_MEL_2	Null fields are not allowed
V_MEL_3	The field “date/time from” must be earlier than the field “date/time to”
V_MEL_4	If the submission has been received via EDT then the MEL “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.

Rule Number	Description
V_MEL_5	The MEL “date/time to” field must be earlier than or equal to the Submission Maximum Date
V_MEL_6	The MEL “date/time from” field must be later than or equal to the Notification Time.

3.8 Valid Maximum Import Limits

A Maximum Import Limit (MIL) record consists of the following fields.

- A date/time from.
- A MIL level from (units of MW).
- A date/time to.
- A MIL level to (units of MW).

Rule Number	Description
V_MIL_1	The fields “MIL level from” and “MIL level to” must be integers greater than or equal to -9999MW and less than or equal to 0MW
V_MIL_2	Null fields are not allowed
V_MIL_3	The field “date/time from” must be earlier than the field “date/time to”
V_MIL_4	If the submission has been received via EDT then the MIL “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.
V_MIL_5	The MIL “date/time to” field must be earlier than or equal to the Submission Maximum Date.
V_MIL_6	The MIL “date/time from” field must be later than or equal to the Notification Time.

3.9 Valid Run-up and Run-down Rates


Under NETA submissions can be made for run-up and run-down rates which correspond to changes in the production and consumption of power. Hence a given BMU can have four sets of rates and breakpoints in the following way.

- A set of parameters describing run-up rates when exporting.
- A set of parameters describing run-down rates when exporting.

- A set of parameters describing run-up rates when importing.
- A set of parameters describing run-down rates when importing.

Reference 1 uses the abbreviation ^gRUR and ^gRUE for the run-up rates and the elbow points for a given BMU. The ^g superscripts for the run-up dynamics of an exporting BMU are described in detail but the use of this superscript for an importing BMU is less well defined (there is a simple statement that in this case ^g will be less than zero). Similar abbreviations are proposed for run-down dynamics.

It has proved very difficult to use the proposed negative ^g superscripts in a logical way and as a result this document deviates from the proposal in reference 1 and will instead use the abbreviations given below.

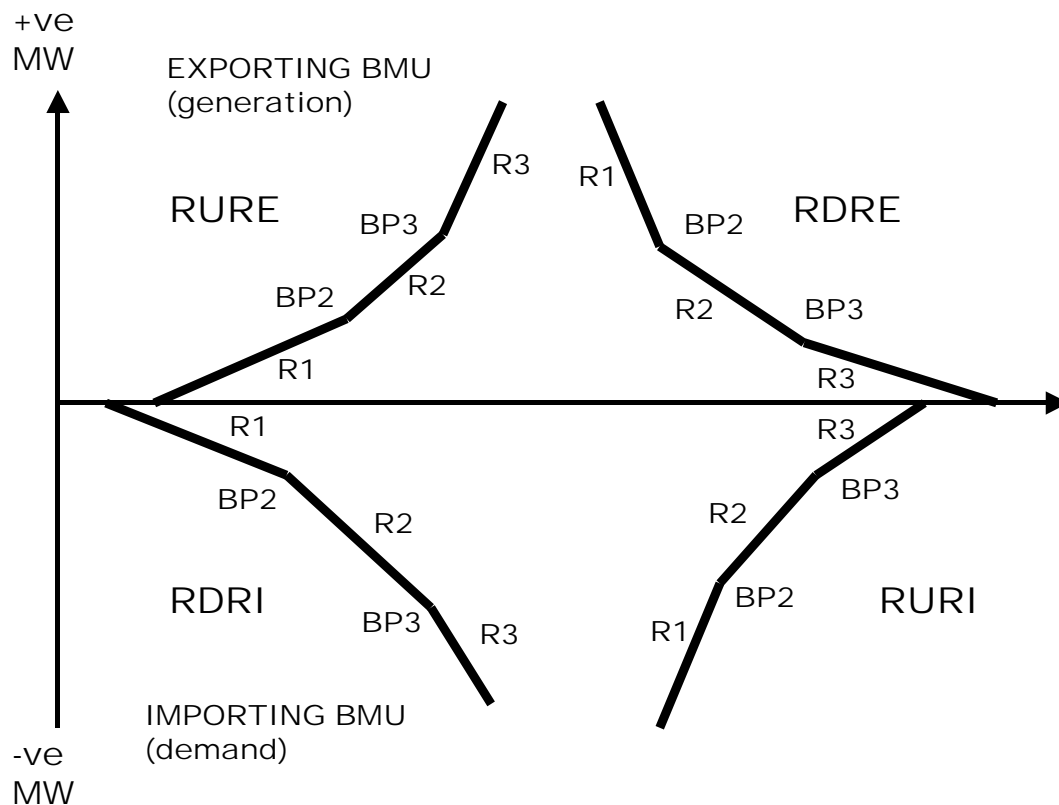

3.9.1 Valid Run-up Rates for an Exporting BMU

A record for the Run-up Rates of an Exporting BMU (RURE) consists of the following fields.

- Effective time (EDT submissions use this field - the concept does not exist in EDL).
- First Run-up Rate (abbreviation RURE_R1, units MW/minute).
- Second Run-up Rate Breakpoint (abbreviation RURE_BP2, units MW).
- Second Run-up Rate (abbreviation RURE_R2, units MW/minute).
- Third Run-up Rate Breakpoint (abbreviation RURE_BP3, units MW).
- Third Run-up Rate (abbreviation RURE_R3, units MW/minute).

Rule Number	Description
V_RURE_1	<p>The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date.</p> <p>If the field has a valid Operational Day start date/time then these run-up rates will only be used for planning purposes.</p>

Rule Number	Description
V_RURE_2	<p>The following are the only valid combinations of rates and breakpoint fields allowed</p> <p><u>1st valid combination</u></p> <p>RURE_R1 = NOT NULL RURE_BP2 = NULL RURE_R2 = NULL RURE_BP3 = NULL RURE_R3 = NULL</p> <p><u>2nd valid combination</u></p> <p>RURE_R1 = NOT NULL RURE_BP2 = NOT NULL RURE_R2 = NOT NULL RURE_BP3 = NULL RURE_R3 = NULL</p> <p><u>3rd valid combination</u></p> <p>RURE_R1 = NOT NULL RURE_BP2 = NOT NULL RURE_R2 = NOT NULL RURE_BP3 = NOT NULL RURE_R3 = NOT NULL</p>
V_RURE_3	<p>If a run-up rate field is not null it must be a real number, accurate to 1 decimal place, greater than or equal to 0.2MW/minute and less than or equal to 999.0MW/minute.</p>
V_RURE_4	<p>If a run-up rate breakpoint field is not null it must be an integer greater than or equal to 1MW and less than or equal to 9999MW</p>
V_RURE_5	<p>If both run-up rate breakpoints are not null then the field “Second Run-up Rate Breakpoint” must be less than the field “Third Run-up Rate Breakpoint”</p>

3.9.2 Valid Run-down Rates for an Exporting BMU

A record for the Run-down Rates of an Exporting BMU (RDRE) consists of the following fields.

- Effective time (EDT submissions use this field - the concept does not exist in EDL).
- First Run-down Rate (abbreviation RDRE_R1, units MW/minute).
- Second Run-down Rate Breakpoint (abbreviation RDRE_BP2, units MW).
- Second Run-down Rate (abbreviation RDRE_R2, units MW/minute).
- Third Run-down Rate Breakpoint (abbreviation RDRE_BP3, units MW).
- Third Run-down Rate (abbreviation RDRE_R3, units MW/minute).

Rule Number	Description
V_RDRE_1	<p>The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date.</p> <p>If the field has a valid Operational Day start date/time then these run-down rates will only be used for planning purposes.</p>

Rule Number	Description
V_RDRE_2	<p>The following are the only valid combinations of rates and breakpoint fields allowed</p> <p><u>1st valid combination</u></p> <p>RDRE_R1 = NOT NULL RDRE_BP2 = NULL RDRE_R2 = NULL RDRE_BP3 = NULL RDRE_R3 = NULL</p> <p><u>2nd valid combination</u></p> <p>RDRE_R1 = NOT NULL RDRE_BP2 = NOT NULL RDRE_R2 = NOT NULL RDRE_BP3 = NULL RDRE_R3 = NULL</p> <p><u>3rd valid combination</u></p> <p>RDRE_R1 = NOT NULL RDRE_BP2 = NOT NULL RDRE_R2 = NOT NULL RDRE_BP3 = NOT NULL RDRE_R3 = NOT NULL</p>
V_RDRE_3	If a run-down rate field is not null it must be a real, accurate to 1 decimal place, greater than or equal to 0.2MW/minute and less than or equal to 999.0MW/minute.
V_RDRE_4	If a run-down rate breakpoint field is not null it must be an integer greater than or equal to 1MW and less than or equal to 9999MW
V_RDRE_5	If both run-down rate breakpoints are not null then the field "Second Run-down Rate Breakpoint" must be greater than the field "Third Run-down Rate Breakpoint"

3.9.3 Valid Run-up Rates for an Importing BMU

A record for the Run-up Rates of an Importing BMU (RURI) consists of the following fields.

- Effective time (EDT submissions use this field - the concept does not exist in EDL).
- First Run-up Rate (abbreviation RURI_R1, units MW/minute).
- Second Run-up Rate Breakpoint (abbreviation RURI_BP2, units MW).
- Second Run-up Rate (abbreviation RURI_R2, units MW/minute).
- Third Run-up Rate Breakpoint (abbreviation RURI_BP3, units MW).
- Third Run-up Rate (abbreviation RURI_R3, units MW/minute).

Rule Number	Description
V_RURI_1	<p>The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date.</p> <p>If the field has a valid Operational Day start date/time then these run-up rates will only be used for planning purposes.</p>

Rule Number	Description
V_RURI_2	<p>The following are the only valid combinations of rates and breakpoint fields allowed</p> <p><u>1st valid combination</u></p> <p>RURI_R1 = NOT NULL RURI_BP2 = NULL RURI_R2 = NULL RURI_BP3 = NULL RURI_R3 = NULL</p> <p><u>2nd valid combination</u></p> <p>RURI_R1 = NOT NULL RURI_BP2 = NOT NULL RURI_R2 = NOT NULL RURI_BP3 = NULL RURI_R3 = NULL</p> <p><u>3rd valid combination</u></p> <p>RURI_R1 = NOT NULL RURI_BP2 = NOT NULL RURI_R2 = NOT NULL RURI_BP3 = NOT NULL RURI_R3 = NOT NULL</p>
V_RURI_3	<p>If a run-up rate field is not null it must be a real number, accurate to 1 decimal place, greater than or equal to 0.2MW/minute and less than or equal to 999.0MW/minute.</p>
V_RURI_4	<p>If a run-up rate breakpoint field is not null it must be an integer greater than or equal to -9999MW and less than or equal to -1MW</p>
V_RURI_5	<p>If both run-up rate breakpoints are not null then the field "Second Run-up Rate Breakpoint" must be less than the field "Third Run-up Rate Breakpoint"</p>

3.9.4 Valid Run-down Rates for an Importing BMU

A record for the Run-down Rates of an Importing BMU (RDRI) consists of the following fields.

- Effective time (EDT submissions use this field - the concept does not exist in EDL).
- First Run-down Rate (abbreviation RDRI_R1, units MW/minute).
- Second Run-down Rate Breakpoint (abbreviation RDRI_BP2, units MW).
- Second Run-down Rate (abbreviation RDRI_R2, units MW/minute).
- Third Run-down Rate Breakpoint (abbreviation RDRI_BP3, units MW).
- Third Run-down Rate (abbreviation RDRI_R3, units MW/minute).

Rule Number	Description
V_RDRI_1	<p>The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date.</p> <p>If the field has a valid Operational Day start date/time then these run-down rates will only be used for planning purposes.</p>

Rule Number	Description
V_RDRI_2	<p>The following are the only valid combinations of rates and breakpoint fields allowed</p> <p><u>1st valid combination</u></p> <p>RDRI_R1 = NOT NULL RDRI_BP2 = NULL RDRI_R2 = NULL RDRI_BP3 = NULL RDRI_R3 = NULL</p> <p><u>2nd valid combination</u></p> <p>RDRI_R1 = NOT NULL RDRI_BP2 = NOT NULL RDRI_R2 = NOT NULL RDRI_BP3 = NULL RDRI_R3 = NULL</p> <p><u>3rd valid combination</u></p> <p>RDRI_R1 = NOT NULL RDRI_BP2 = NOT NULL RDRI_R2 = NOT NULL RDRI_BP3 = NOT NULL RDRI_R3 = NOT NULL</p>
V_RDRI_3	If a run-down rate field is not null it must be a real, accurate to 1 decimal place, greater than or equal to 0.2MW/minute and less than or equal to 999.0MW/minute.
V_RDRI_4	If a run-down rate breakpoint field is not null it must be an integer greater than or equal to -9999MW and less than or equal to -1MW
V_RDRI_5	If both run-down rate breakpoints are not null then the field "Second Run-up Rate Breakpoint" must be greater than the field "Third Run-up Rate Breakpoint"

3.10 Valid Notice to Deviate from Zero

A Notice to Deviate from Zero (NDZ) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An NDZ value (units of minutes).

Rule Number	Description
V_NDZ_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_NDZ_2	The field “NDZ value” cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to 999 minutes

3.11 Valid Notice to Deliver Offers

A Notice to Deliver Offers (NTO) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An NTO value (units of minutes).

Rule Number	Description
V_NTO_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_NTO_2	The field “NTO value” cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to N minutes

3.12 Valid Notice to Deliver Bids

A Notice to Deliver Bids (NTB) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An NTB value (units of minutes).

Rule Number	Description
V_NTB_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_NTB_2	The field “NTB value” cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to N minutes

3.13 Valid Minimum Zero Time

A Minimum Zero Time (MZT) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An MZT value (units of minutes).

Rule Number	Description
V_MZT_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.

Rule Number	Description
V_MZT_2	The field “MZT value” cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to 999 minutes

3.14 Valid Minimum Non-Zero Time

A Minimum Non-zero Time (MNZT) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An MNZT value (units of minutes).

Rule Number	Description
V_MNZT_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_MNZT_2	The field “MNZT value” cannot be null and must be an integer greater than or equal to 0 minutes and less than or equal to 999 minutes

3.15 Valid Stable Export Limit

A Stable Export Limit (SEL) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An SEL value (units of MW).

Rule Number	Description
V_SEL_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_SEL_2	The field “SEL value” cannot be null and must be an integer greater than or equal to 0MW and less than or equal to 9999MW

3.16 Valid Stable Import Limit

A Stable Import Limit (SIL) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An SIL value (units of MW).

Rule Number	Description
V_SIL_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_SIL_2	The field “SIL value” cannot be null and must be an integer greater than or equal to -9999MW and less than or equal to 0MW

3.17 Valid Maximum Delivery Volume

A Maximum Delivery Volume (MDV) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An MDV value (units of MWh).

Rule Number	Description
V_MDV_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_MDV_2	The field “MDV value” cannot be null and must be an integer greater than or equal to U MWh and less than or equal to V MWh

3.18 Valid Maximum Delivery Period

A Maximum Delivery Period (MDP) record consists of the following fields.

- An effective time (EDT submissions use this field - the concept does not exist in EDL).
- An MDP value (units of minutes).

Rule Number	Description
V_MDP_1	The “effective time” field is only relevant to EDT submissions and can only have a value corresponding to the start date/time of a future Operational Day (note times are in GMT). The “effective time” cannot be later than the Submission Maximum Date. If the field has a valid Operational Day start date/time then this submission will only be used for planning purposes.
V_MDP_2	The field “MDP value” cannot be null and must be an integer greater than or equal to 1 minute and less than or equal to M minutes

4 CONSISTENCY

4.1 Physical Notification Consistency Rules

Physical Notification records are submitted via EDT flat files. Within an EDT file there is no implied ordering and as a result records for the same BMU cannot cover the same time period. If the records did cover the same time period it would be impossible to determine which record took precedence.

There is also a requirement that a Physical Notification for a given BMU must be submitted for every half hour period start “date/time” covered by the submission and that the records submitted must cover complete half hour periods. For example the following combination of to and from date/times is acceptable

“from date/time”	“to date/time”
2000-02-07 10:00	2000-02-07 10:15
2000-02-07 10:15	2000-02-07 10:30
2000-02-07 10:30	2000-02-07 11:00

However this combination

“from date/time”	“to date/time”
2000-02-07 10:00	2000-02-07 10:15
2000-02-07 10:16	2000-02-07 10:31
2000-02-07 10:31	2000-02-07 10:59

will fail consistency checking because there is a gap in the records between 10:15 and 10:16, the record starting at 10:16 and extending to 10:31 goes beyond the settlement half hour end time of 10:30, there is no record corresponding to the settlement period start of 10:30, and there is a gap between 10:59 and the end of the settlement period given by 11:00.

Rule Number	Description
C_PN_1	Physical Notification records, for the same BMU, with the same Notification Time must cover distinct time ranges.
C_PN_2	Physical Notification records, for the same BMU, with the same Notification Time must cover complete settlement half hour periods. In addition a sub-set of the records must have “date/time” fields corresponding to the start of each half hour period covered.

4.2 Quiescent Physical Notification Rules

The clarification comments given in section 4.1 for physical notifications are equally applicable to quiescent physical notifications.

Rule Number	Description
C_QPN_1	Quiescent Physical Notification records, for the same BMU, with the same Notification Time must cover distinct time ranges.
C_QPN_2	Quiescent Physical Notification records, for the same BMU, with the same Notification Time must cover complete settlement half hour periods. In addition a sub-set of the records must have “date/time” fields corresponding to the start of each half hour period covered.

4.3 Bid-offer Consistency Rules

A bid-offer set is defined as those bid-offer records, for a given BMU, that have the same Notification Times, the same “date/time from” fields, and the same “date/time to” fields.

Rule Number	Description
C_BOD_1	Bid-offer sets must cover distinct time ranges.
C_BOD_2	For a given bid-offer set “offer prices” submitted must not decrease as the values of the “bid-offer pair number” increases, i.e. prices must be monotonically non-decreasing
C_BOD_3	For a given bid-offer set “bid prices” submitted must not decrease as the values of the “bid-offer pair number” increases, i.e. prices must be monotonically non-decreasing
C_BOD_4	Each bid-offer set must contain bid-offer records corresponding to the “bid-offer pair numbers” +1 and -1 and for a given bid-offer set the “bid-offer pair numbers” must be continuous (with the exception that 0 is not an allowed value).
C_BOD_5	For a given bid-offer set the “offer price” must be equal to or greater than the “bid price” for each individual “bid-offer pair number”.

Rule Number	Description
C_BOD_6	For a given bid-offer set, the fields “bid-offer level from” and “bid-offer level to”, for all bid-offer pairs other than the pair with the highest positive “bid-offer pair number” and the pair with the lowest negative “bid-offer pair number”, must not be zero.

4.4 Maximum Export Limit Consistency Rules

Rule Number	Description
C_MEL_1	Maximum Export Limit records, for the same BMU, with the same Notification Time must cover distinct time ranges.

4.5 Maximum Import Limit Consistency Rules

Rule Number	Description
C_MIL_1	Maximum Import Limit records, for the same BMU, with the same Notification Time must cover distinct time ranges.

5 DEFAULTS

5.1 Default Data

It should be noted that, in general, if defaulted data is not overwritten by subsequent submissions it will become operational data. The exception to this statement is planning dynamic data which is never used to call off bid-offers in the balancing mechanism.

For each of the following data types: Physical Notifications, Quiescent Physical Notifications, Maximum Export Limit and Minimum Import Limit, there are two different defaulting rules available. However for each BMU and data type only one rule will be applied. In the absence of any request to apply a specific rule for any BMU and data type, the first rule will be applied as a matter of course, i.e. D_PN_1, D_QPN_1, D_MEL_1 or D_MIL_1, unless it relates to an External Interconnection, in which case the second rule will in the absence of any such request apply. The decision as to which rule can be applied to a specific BMU and data type is the responsibility of the system operator.

Data defaulting is applied where the submitted data is not complete for any Operational Day at the relevant time. For example, at 1999-12-06 11:00 if there were a gap in data covering a period from 1999-12-07 13:00 to 1999-12-07 14:00 (that is in the following Operational Day) then default data would be generated to fill the gap. Using the first rule, the data from 1999-12-06 13:00 to 1999-12-06 14:00 would be copied to fill the gap. This data would include all updates that had been made up to 1999-12-06 11:00 for that time period. Using the second rule (i.e. D_PN_2, D_QPN_2, D_MEL_2 or D_MIL_2), this gap would be filled with zero level data.

5.2 Defaulting and Clock change Days

For real-time systems operating twenty-four hours per day in local time, an issue exists with duplicated and missing hours as local time changes between time standards. In general, the clock change occurs in the early hours (at 01:00 GMT) on a Sunday. The nature of the Operational Day (05:00 to 05:00 local time) means that the clock change occurs towards the end of the Saturday Operational Day. As a result of the clock change, a Short Day (23hrs) occurs in spring and a Long Day (25hrs) occurs in autumn.

On the basis of these assumptions, the following table describes the mechanism used to generate default data where gaps exist in the data submitted. The table defines the mechanism for each of the Operational Days before, during and after each clock change. The last column defines, for each day, the source of data for any gaps in that Operational Day for which defaulting is done. Note that all times shown in the table are in local time.

The method adopted preserves the local time profiles for data from Operational Days before to those after the Operational Day in which the clock change falls. However, on the clock change Operational Days themselves, there is a shift in data for part of the day. In the case of the spring clock change, periods after the clock change are shifted one hour later according to local time. In the case of the autumn clock change, periods before the clock change are shifted one hour later according to local time.

Clock Change	Operational Day	Day Type	When Defaulted	Default Mechanism
Spring	Friday	GMT	11:00 Thursday	Copy data from period 24 hours earlier
	Saturday	Short Day	11:00 Friday	Copy data from period 24 hours earlier
	Sunday	BST	11:00 Saturday	For periods from 05:00 to 04:00: Copy data from period 23 hours earlier For periods from 04:00 to 05:00: Copy data from period 47 hours earlier
Autumn	Friday	BST	11:00 Thursday	Copy data from period 24 hours earlier
	Saturday	Long Day	11:00 Friday	Copy data from period 25 hours earlier
	Sunday	GMT	11:00 Saturday	Copy data from period 24 hours earlier

5.3 Default Rule for Physical Notifications

Rule Number	Description
D_PN_1	Day ahead Physical Notifications must be submitted for every BMU by 11:00 local time. If no Physical Notification submission, or a partial submission, has been made by 11:00 the data for the current Operational Day will be copied forward to fill gaps in the next Operational Day.
D_PN_2	Day ahead Physical Notifications must be submitted for every BMU by 11:00 local time. If no Physical Notification submission, or a partial submission, has been made by 11:00 a zero profile will be applied to fill gaps in data for the next Operational Day.

N.B. Either D_PN_1 or D_PN_2 will be applied for each BMU.

5.4 Default Rule for Quiescent Physical Notifications

Rule Number	Description
D_QPN_1	<p>Day ahead Quiescent Physical Notifications must be submitted for every BMU by 11:00 local time.</p> <p>If no Quiescent Physical Notification submission, or a partial submission, has been made by 11:00 the data for the current Operational Day will be copied forward to fill gaps in the next Operational Day.</p>
D_QPN_2	<p>Day ahead Quiescent Physical Notifications must be submitted for every BMU by 11:00 local time.</p> <p>If no Quiescent Physical Notification submission, or a partial submission, has been made by 11:00 a zero profile will be applied to fill gaps in data for the next Operational Day.</p>

N.B. Either D_QPN_1 or D_QPN_2 will be applied for each BMU.

5.5 Default Rule for Maximum Export Limit

Rule Number	Description
D_MEL_1	<p>Day ahead Maximum Export Limits must be submitted for every BMU by 11:00 local time.</p> <p>If no Maximum Export Limit submission, or a partial submission, has been made by 11:00 the data for the current Operational Day will be copied forward to fill gaps in the next Operational Day.</p>
D_MEL_2	<p>Day ahead Maximum Export Limits must be submitted for every BMU by 11:00 local time.</p> <p>If no Maximum Export Limit submission, or a partial submission, has been made by 11:00 a zero profile will be applied to fill gaps in data for the next Operational Day.</p>

N.B. Either D_MEL_1 or D_MEL_2 will be applied for each BMU.

5.6 Default Rule for Maximum Import Limit

Rule Number	Description
D_MIL_1	Day ahead Maximum Import Limits must be submitted for every BMU by 11:00 local time. If no Maximum Import Limit submission, or a partial submission, has been made by 11:00 the data for the current Operational Day will be copied forward to fill gaps in the next Operational Day.
D_MIL_2	Day ahead Maximum Import Limits must be submitted for every BMU by 11:00 local time. If no Maximum Import Limit submission, or a partial submission, has been made by 11:00 a zero profile will be applied to fill gaps in data for the next Operational Day

N.B. Either D_MIL_1 or D_MIL_2 will be applied for each BMU.

5.7 Default Rule for Planning Dynamic Data

Rule Number	Description
D_PLAN_1	The following planning dynamic data must be submitted for every BMU by 11:00 local time, RURE, RDRE, RURI, RDRI, NDZ, NTO, NTB, MZT, MNZT, SEL, SIL, MDV and MDP. This data will only be used for planning purposes. In the event that any data item from the above list has not been submitted the previous days value for that planning data item will be copied forward and used for planning purposes

Note that there is no default rule for operational dynamic data. The last submitted value always applies and in the absence of any submissions the value given during BMU commissioning will be used.

5.8 Default Rules for Bid-Offer Data

Rule Number	Description
D_BOD_1	Day ahead bid-offer data may be submitted for every BMU by 11:00 local time. If no bid-offer submission, or a partial submission, has been made by 11:00 the data for the current Operational Day will be copied forward to fill gaps in the next Operational Day.

6 INITIAL DATA

When a BM unit is registered by National Grid and setup within the BM a set of initial values for each of the submitted data items is given. These values are used in the absence of a submission from the responsible Trading Agent/Control Point.

The following values are used for the following data types:

- MEL,PN,QPN,MIL,SEL,SIL,BOD,NDZ,MZT & MNZT are all zero.
- RURE,RDRE,RURI & RDRI is 10.
- MDP is 1
- MDV is 99999
- NTO & NTB is 2

APPENDIX A: CLARIFICATION OF GATE CLOSURE AND SUBMISSION MAXIMUM DATE

The concepts of Gate Closure and Submission Maximum Date are used throughout this document and are of central importance when applying some of the rules given. This appendix expands the explanations given in section 1.3.

Data submitted is time stamped with the time when a transfer to the NGC system is complete – this is known as the Notification Time. This Notification Time is used to define Gate Closure and the Submission Maximum Date for the data within the submission.

A.1 Gate Closure

As an example of Gate Closure and the Gate Closure Period consider a submission which has a Notification Time of 2000-03-03 10:00. Consider how the validation rule V_PN_4 would be applied. This rule states that the Physical Notification “date/time from” field must be later than or equal to the end of the last Settlement Period for which Gate Closure has occurred at the Notification Time.

For this Notification Time the last Gate Closure occurred at 2000-03-03 10:00. We take the Gate Closure Period as 1 hour. This latest Gate Closure therefore occurs for the Settlement Period commencing one hour after this time, i.e. 2000-03-03 11:00. Thus, the end of the Settlement Period for which Gate Closure has occurred is 2000-03-03 11:30. As a result all Physical Notifications in this submission must have a “date/time from” field with date/times later than or equal to 2000-03-03 11:30.

Because Gate Closure is always on a half-hour period the same date/times apply for submissions with Notification Times up to 2000-03-03 10:30. So if a submission had a Notification Time of 2000-03-03 10:29 the values quoted in the last paragraph would still apply.

However for a submission with a Notification Time of 2000-03-03 10:30, the most recent Gate Closure would be at 2000-03-03 10:30 and all times quoted above would increase by 30 minutes.

A.2 Submission Maximum Date

The following tables provide examples of the calculation of the Submission Maximum Date.

Note that Notification Times and the Submission Maximum Date should be used in the GMT time convention as they relate to data in a submission which is always in GMT.

However it is easier to think in local time and then convert to GMT because the concept of a Submission Maximum Date is related to the Operational Day which runs from 05:00 to 05:00 local time.

The following table gives examples of the calculation of the Submission Maximum Date over a spring clock change on 2000-03-26.

Notification Times			Days Added	Submission Maximum Date		
Date	Local Time	GMT		Date	Local Time	GMT
2000-03-20	10:59	10:59	4	2000-03-25	05:00	05:00
2000-03-20	11:00	11:00	5	2000-03-26	05:00	04:00
2000-03-24	03:59	03:59	5	2000-03-29	05:00	04:00
2000-03-24	04:00	04:00	5	2000-03-29	05:00	04:00
2000-03-24	04:59	04:59	5	2000-03-29	05:00	04:00
2000-03-24	05:00	05:00	4	2000-03-29	05:00	04:00
2000-03-24	10:59	10:59	4	2000-03-29	05:00	04:00
2000-03-24	11:00	11:00	5	2000-03-30	05:00	04:00
2000-03-25	03:59	03:59	5	2000-03-30	05:00	04:00
2000-03-25	04:00	04:00	5	2000-03-30	05:00	04:00
2000-03-25	04:59	04:59	5	2000-03-30	05:00	04:00
2000-03-25	05:00	05:00	4	2000-03-30	05:00	04:00
2000-03-25	10:59	10:59	4	2000-03-30	05:00	04:00
2000-03-25	11:00	11:00	5	2000-03-31	05:00	04:00
2000-03-26	03:59	02:59	5	2000-03-31	05:00	04:00
2000-03-26	04:00	03:00	5	2000-03-31	05:00	04:00
2000-03-26	04:59	03:59	5	2000-03-31	05:00	04:00
2000-03-26	05:00	04:00	4	2000-03-31	05:00	04:00
2000-03-26	10:59	09:59	4	2000-03-31	05:00	04:00
2000-03-26	11:00	10:00	5	2000-04-01	05:00	04:00

DOCUMENT STATUS

Template Version 3.0

PRODUCT DESCRIPTION REFERENCE

IS/24.22.0023

AMENDMENT RECORD

Issue	Draft	Date	Author	Description of changes
8		2/11/11	RDG	Updates after review Update value for N
8	1	24/10/11	RDG	Add validation rule V_BOD_11 Add section 6: Initial values
7		11/10/04	PH	Authority approval of Issue 7 draft 1 changes
7	1	3/11/03	PH	Replace Generation Capacity with Connection Entry Capacity or equivalent.
6		25/05/04	RDG	Authority approval of Issue 6 draft 1 changes
6	1	19/11/02	RDG	Introduce D_PN_2, D_QPN_1, D_MEL_1, D_MIL_1 as alternative rules for data defaulting. Modify Gate Closure parameter from 3.5 to 1 hours
5		19/12/00	DJB	Include comments from internal review.
5	1	06/12/00	DJB	Include notes on how clock change affects defaulting rules and other clarifications. Removed rules: D_BOD_2; D_BOD_3; D_BOD_4. NGC Events: 2540, 2539, 2744
4		24/05/00	JMW	Included comments from internal reviews. Added new rule C_BOD_6. Added clarification for rule V_GEN_5 and V_BOD_6
4	1	17/05/00	MBD	Included new rules V_GEN_5, V_MEL_6 and V_MIL_6. Added clarification for rule C_BOD_4.
3		14/03/00	MBD	Final comments included before issued
2		10/02/00	MBD	Final changes before release to PDO
1		28/01/00	MBD	Included final internal review comments

CHANGE FORECAST

Once issued, this document is not expected to change, however if it does, it will be reissued whole.

DISTRIBUTION

Copies	Destination
1	IS Librarian
1	NGC Industry Website
1	OFGEM NETA Programme Development Office

Retention Table

Type of Document	Responsibility	Retention Period
Rules	Design Authority	7 years

— End of Document —