


GB DEMAND USE OF SYSTEM  
TARIFF ZONES 2008/09

- 400kV Substations ■
- 275kV Substations ■
- 132kV Substations ●
- 400kV Circuits —
- 275kV Circuits —
- 132kV Circuits —

Major Generating Sites  
Including Pumped Storage

- Connected at 400kV ○
- Connected at 275kV ○
- Hydro Generation ○

THE SHETLAND ISLANDS

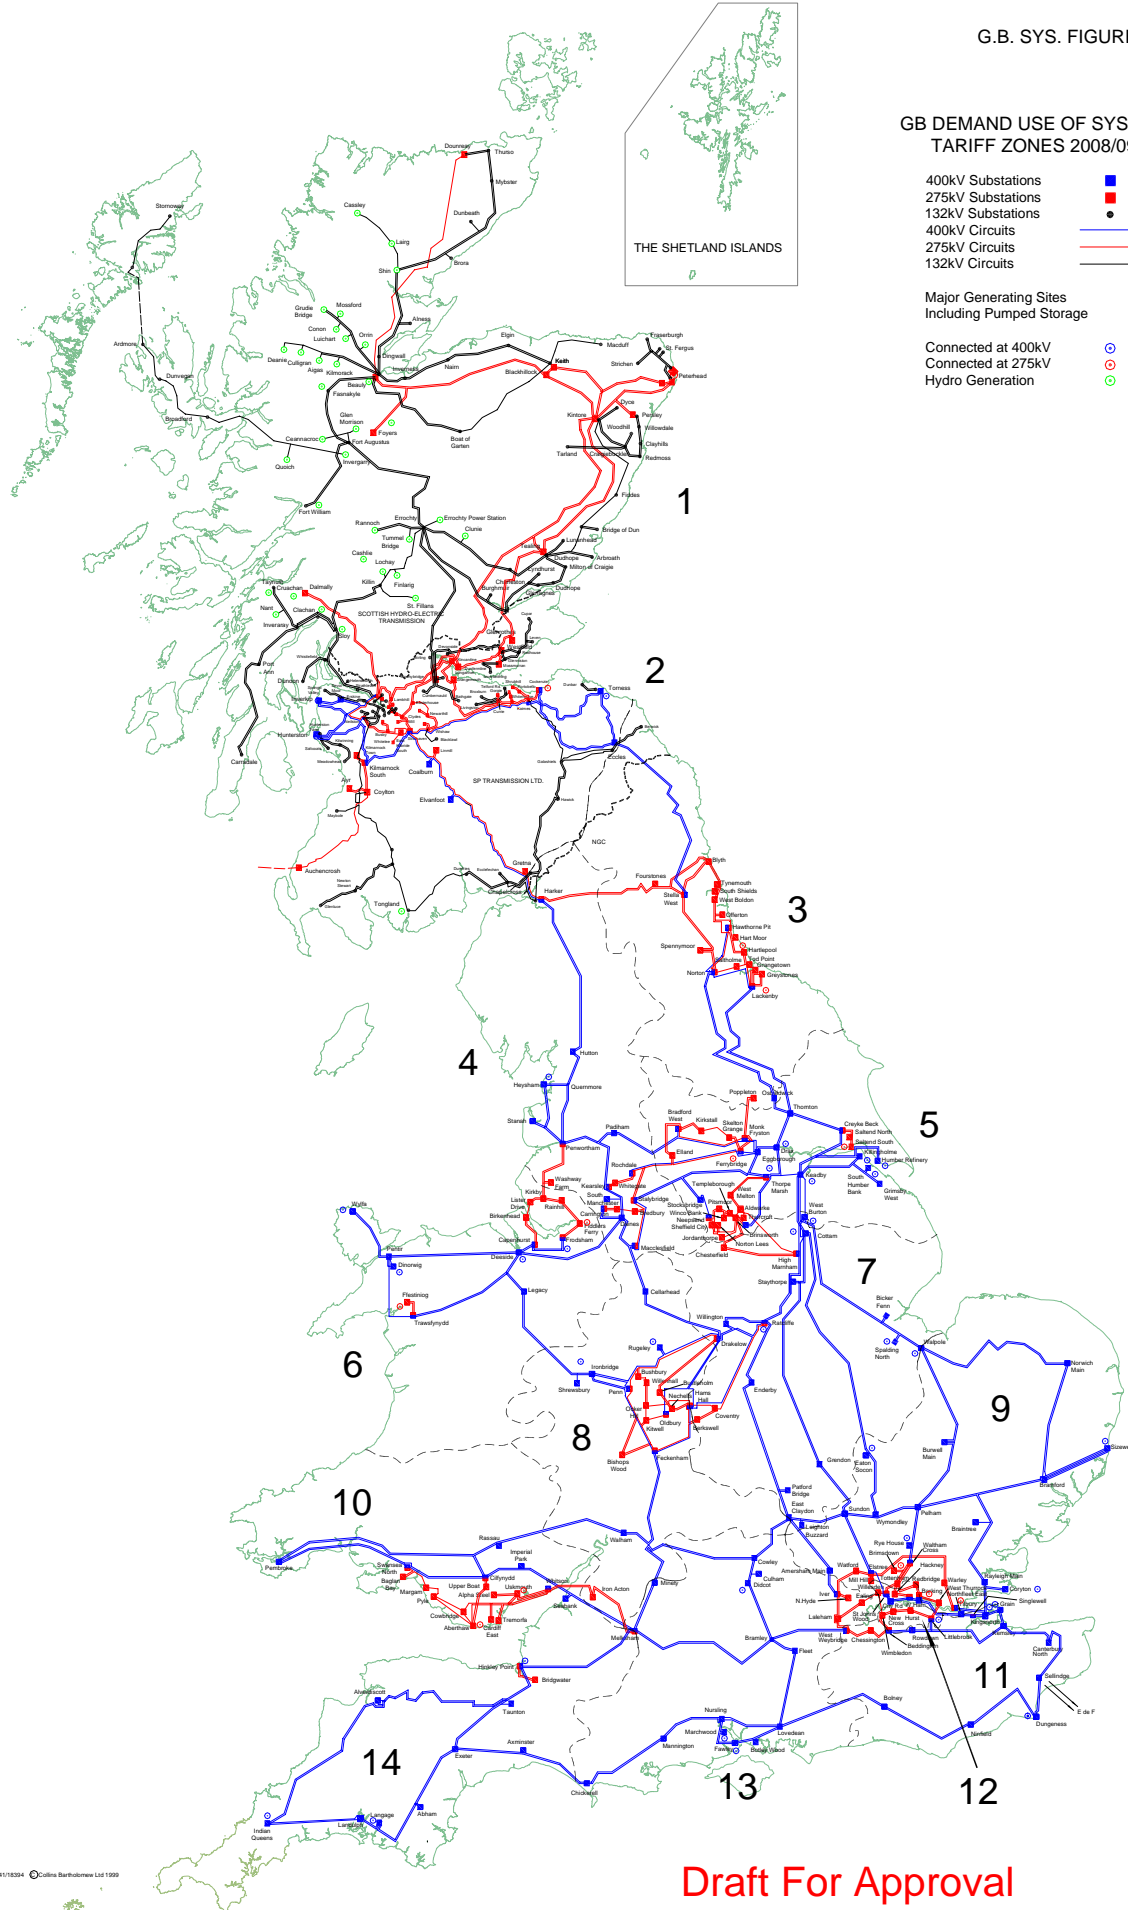

**Draft For Approval**